


NOTES:

ALL MATERIALS USED IN THE DRAINAGE SYSTEM CONFORM TO NFPA 1192 7.1.1
 DRAIN GRADE SET AT 1/8 INCH PER FOOT MINIMUM
 DRAIN LINES ARE SUPPORTED AT A MAXIMUM INTERVAL OF 4 FEET
 ALL TANK HOOKUPS ARE A DOUBLE LTTY UNLESS SPECIFIED OTHERWISE
 IN OR BELOW MAIN FLOOR
 SEE WASHER TYPICAL FOR WASHER PLUMBING
 SEE HOLDING TANK TYPICAL FOR TERMINATION PLUMBING
 ALL TRAPS ARE REMOVABLE FOR USE AS A CLEANOUT ACCESS
 * -- DENOTES 1 1/2" DAF-FLEX

SIZE OF TRAP ARM (IN.)	DISTANCE FROM TRAP TO VENT (FT.)
1 1/4	4 1/2
1 1/2	4 1/2
2	5
3	6

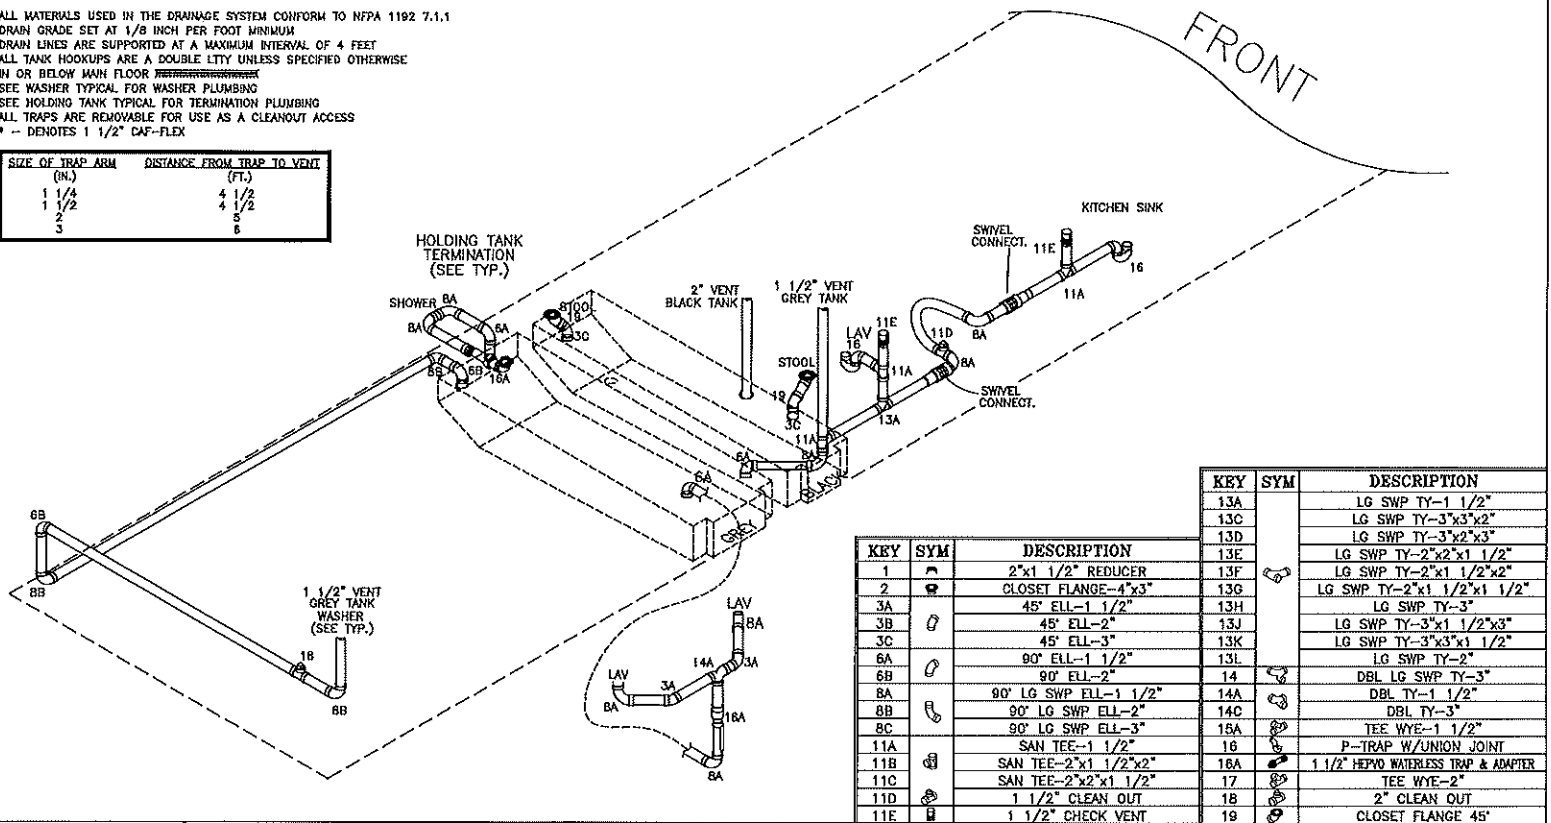

KEY	SYM	DESCRIPTION
1		2"x1 1/2" REDUCER
2		CLOSET FLANGE-4"x3"
3A		45° ELL-1 1/2"
3B		45° ELL-2"
3C		45° ELL-3"
6A		90° ELL-1 1/2"
6B		90° ELL-2"
8A		90° LG SWP ELL-1 1/2"
8B		90° LG SWP ELL-2"
8C		90° LG SWP ELL-3"
11A		SAN TEE-1 1/2"
11B		SAN TEE-2"x1 1/2"x2"
11C		SAN TEE-2"x2"x1 1/2"
11D		1 1/2" CLEAN OUT
11E		1 1/2" CHECK VENT

KEY	SYM	DESCRIPTION
13A		LG SWP TY-1 1/2"
13C		LG SWP TY-3"x3"x2"
13D		LG SWP TY-3"x2"x3"
13E		LG SWP TY-2"x2"x1 1/2"
13F		LG SWP TY-2"x1 1/2"x2"
13G		LG SWP TY-2"x1 1/2"x1 1/2"
13H		LG SWP TY-3"
13J		LG SWP TY-3"x1 1/2"x3"
13K		LG SWP TY-3"x3"x1 1/2"
13L		LG SWP TY-2"
14		DBL LG SWP TY-3"
14A		DBL TY-1 1/2"
14C		DBL TY-3"
15A		TEE WYE-1 1/2"
16		P-TRAP W/UNION JOINT
16A		1 1/2" HEPVO WATERLESS TRAP & ADAPTER
17		TEE WYE-2"
18		2" CLEAN OUT
19		CLOSET FLANGE 45°

NEWMAR CORP
 P.O. Box 30,
 Nappanee, IN. 46550
 UNITS: INCHES
 TITLE BLOCK: 2016\TITLE\PB_TB-1401_17

Model:
 VL DP 4044
 Title:
 DRAIN PLUMBING

Sheet
 3 OF 3
 I.D. # 2017
 DP\CODE\PLUM\VL
 4044

Drawn by:
 D. E.
 Date:
 3/11/16

Checked by:
 R. R.
 Date:
 3/24/16

Revision:
 Revision:
 Revision:

By:
 Date:
 By:
 Date: